

**REACTION TO FIRE CLASSIFICATION REPORT  
IN ACCORDANCE WITH PN-EN 13501-1:2019-02**

Contract no. 01844/24/Z00NZP

<b>Sponsor:</b>	<b>WOODPLAST Sp. z o.o.</b> ul. Lwowska 38 40-389 Katowice
<b>Prepared by:</b>	<b>Zakład Badań Ogniwych</b> <b>Instytutu Techniki Budowlanej</b> ul. Filtrowa 1 00-611 Warszawa
<b>Product name:</b>	<b>The terrace system Bruggan Expert Pro</b>
<b>Classification report no.:</b>	<b>1844/24/Z00NZP-ENG</b> (English version of classification 01036/24/Z00NZP)
<b>Issue number:</b>	<b>1</b>
<b>Date of issue:</b>	<b>18.07.2024</b>

This classification report consists of three pages and may only be used or reproduced in its entirety.

**1. Introduction**

This classification report defines the classification assigned to terrace system Bruggan Expert Pro in accordance with the procedures given in PN-EN 13501-1:2019-02.

**2. Details of classified product****2.1 General**

The product is defined as terrace system, and floor covering system used inside the buildings.

**2.2 Product description**

**2.3 The product, is described below.**


Terrace system Bruggan Expert Pro consisting of solid composite board, j aluminum joists and additional elements.

Board composition %:


- 60% wood flour,
- 30% polyethylene,
- 10% functional additives,

Thickness of plank: 23 mm

Aluminum joist dimensions: 40 x 25 mm.

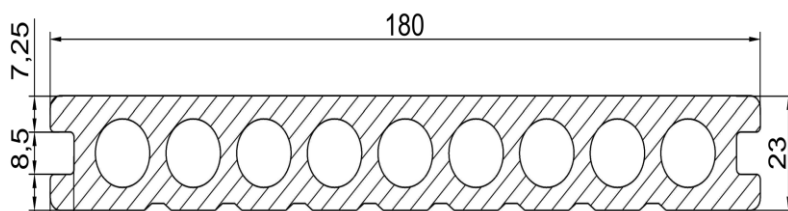

Drawing of plank

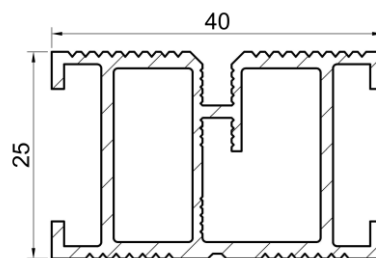

Drawing of an aluminum joist

### 3. Test reports & test results in support of classification

#### 3.1 Test reports

Name of laboratory	Name of sponsor	Test report no.	Test method
Fire Testing Laboratory of ITB	WOODPLAST Sp. z o.o.	LZP02-01036/24/Z00NZP	PN-EN ISO 11925-2:2020-09
		LZP01-01036/24/Z00NZP	PN-EN ISO 9239-1:2010

#### 3.2 Test results

Test method	Parameter	Number of tests	Results	
			Continuous parameter – mean (m)	Compliance with parameters
PN-EN ISO 11925-2:2010 Exposure 15 s	$F_s \leq 150$ mm	6	(-)	Y
PN-EN ISO 9239-1:2010	Critical heat flux (kW/m <sup>2</sup> )	3	11,1	(-)
	Smoke production (%·min)		2,7	(-)

(-): do not concern

Y: Yes

N: No

### 4 Classification and field of application

#### 4.1 Reference of classification

This classification has been carried out in accordance with PN-EN 13501-1:2019-02.

#### 4.2 Classification

Terrace system Bruggan Expert Pro, in relation to its reaction to fire behaviour are classified:

**B<sub>fl</sub>**

The additional classification in relation to smoke production is:

**s1**

The format of the reaction to fire classification for floorings is:

Fire behaviour		Smoke production	
<b>B<sub>fl</sub></b>	-	<b>s</b>	<b>1</b>

i.e.: B<sub>fl</sub>-s1

## Reaction to fire classification: B<sub>fl</sub>-s1

### 4.3 Field of application

This classification is valid for the following product parameters:

- Product described in point 2 this classification report
- Terrace system Bruggan Expert Pro. used on substrates with minimum reaction to fire class A2-s1,d0.

### 5 Limitation

The classification given above remains valid as long as:

- test method remains unchanged,
- product standard or technical approval remains unchanged,
- constructional or material modifications do not exceed limits of the field of application defined in 4.3.

This classification report has been issued in electronic form, with qualified electronic signatures of persons responsible. A printout of this report is not an original document.

This classification document does not represent type approval or certification of the product.

	<b>Signed*</b>	<b>Approved*</b>
Prepared:	electronic signatures	electronic signatures
Verified:	electronic signatures	

\* - For and on behalf of "Name of the organisation"